

RTSI

Reliability Testing Services, Inc.
P.O. Box 365
Genoa, AR 71840
870-653-6838

Location: Paper Machines


Equipment: # 1 A Broke Tower Agitator

Problem: Bearing next to motor shows a temperature rise.

Recommendation: Check lubrication, check with vibration analysis for possible bearing anomaly. Continue to monitor.

Rise: 48

Thermography Report

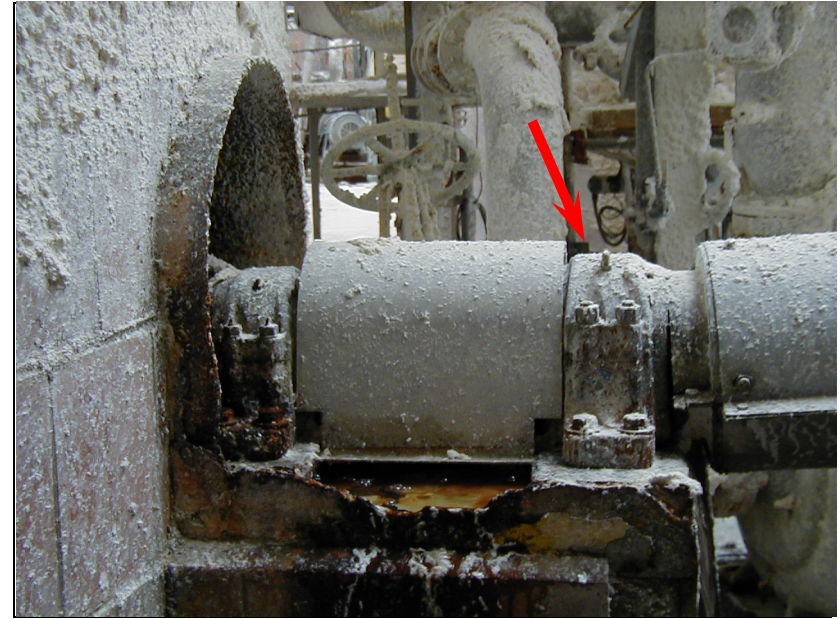

43070006.IRI					
ITEM	TYPE	AVG TEMP	MAX TEMP	MIN TEMP	EMISS
Whole Image	Image	56.95	112.21	29.83	0.92
S1	Spot	62.96	64.38	60.37	0.92
S2	Spot	109.66	112.21	107.43	0.92

**Repair
Comments:**

